

Standards For Fire Pits

Must be made from steel or non-combustible material. Solid structure or if decorative cutouts, they must be screened with 1/8" steel mesh.

Standard pit size—max 36" diameter, between 7 3/8" and 16" high.

Create a 1.5' clearance by removing all combustibles down to mineral soil. Fill cleared area in with gravel or rock. ***Option—dig hole in ground, set pit inside, fill with cement, then create clearance area)*



Create a 10' radius combustible free zone

Create a vertical clearance of 10' by removing overhanging branches

Pit must be 25' from all structures

Pit must be 50' from all logging slash/debris

Pit needs to be maintained (clean out debris after each use)

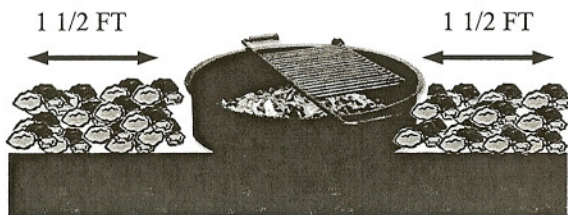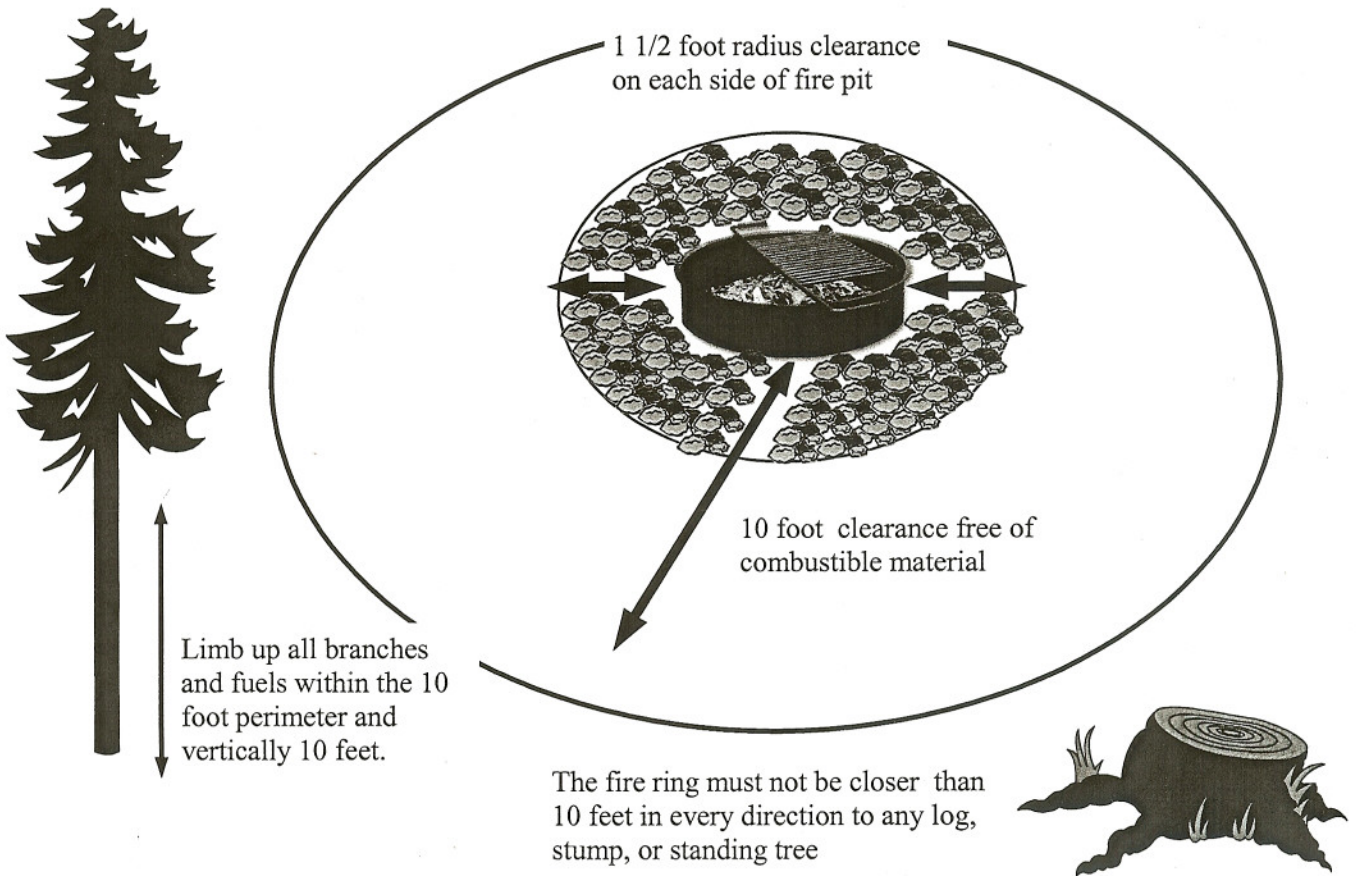

Remove all combustible material down to mineral soil, no less than 1.5' from the perimeter of the fire ring. Fill in with gravel or rock.